

Cerberus[®] PRO Detectors and Peripherals

Photoelectric Smoke Detector [with
ISOtechnology[™]]

Model OP921

Architect & Engineer Specifications

- UL 268 7th Edition Listed
- Built-in *ISOtechnology*[™]
- 252 Isolation devices per SLC
- Each detector is self-testing:
 - Self-monitored for sensitivity with UL Listed limits
 - complete diagnostics performed every 10 seconds
- Compatible with Model 8720 | DPU (device programmer / loop tester)
- Polarity insensitive via *SureWire*[™] technology
- Functions with Model DB-11-series mounting bases
- Tri-color detector-status light-emitting diode (LED) with 360 ° view
- Field-selectable application-sensitivity profiles
- Remote sensitivity-measurement capability
- Utilizes advanced, microprocessor-based signal processing
- Extended temperature-and-humidity operating range
- Automatic environment compensation
- Superior electromagnetic interference (EMI) and radio-frequency interference (RFI) immunity
- Restriction of Hazardous Substances (RoHS compliant)
- UL Listed | FM, CSFM Approved
 - UL 268: 'Open Area Smoke Detection'
 - UL 268A (Duct) - 'In-duct housing' use
 - UL 268A (Duct) - 'Direct-in-Duct' use
 - ULC-S529: 'System Smoke Detector'
 - ULC-S530: 'Heat Actuated Fire Detection'
 - FM 3230
 - CSFM | File: 7272-0067:0258

Product Overview

The Photoelectric Smoke Detector (Model OP921) uses state-of-the-art microcontroller circuitry and surface-mount technology for maximum reliability. Model OP921 incorporates an optical sensor using a light-scattering detection principle. The device utilizes advanced software algorithms to analyze the signals providing highly stable and accurate smoke detection.

Model OP921 is UL 268 7th edition listed incorporating advanced built-in *ISOtechnology*[™] - True Class-X SLC operation (use is optional) greatly improving system reliability and circuit integrity while providing advanced addressable fault finding.

Each detector fits into one (1) wall-or-ceiling footprint, and only occupies one (1) address on the signal-line circuit (SLC)

Model OP921 is a plug-in, two-wire, addressable photoelectric smoke detector whose value is increased with built-in *ISOtechnology* feature. Model OP921 is Underwriters' Laboratories Listed [UL268A Listed for direct in-air duct usage].

Each detector utilizes a dust-resistant photoelectric smoke chamber and microprocessor-based electronics with a low-profile plastic housing. Every Model OP921 fire detector is shipped with a protective dust cover.

Operation


Model OP921 is a wide-spectrum, photoelectric smoke detector that incorporates an infrared light-emitting diode (IRLED), as well as a light-sensing photodiode. Under normal conditions, light transmitted by the LED is directed away from the photodiode and scattered through the smoke chamber in a controlled pattern.

The smoke chamber is designed to manage light dissipation and extraneous reflections from dust particles or other non-smoke, airborne contaminants in such a way as to maintain stable, consistent detector operation. When smoke enters the detector chamber, light emitted from the IRLED is scattered by the smoke particles and is received by the photodiode (see: images on page 2).



Model OP921
Photoelectric Smoke Detector



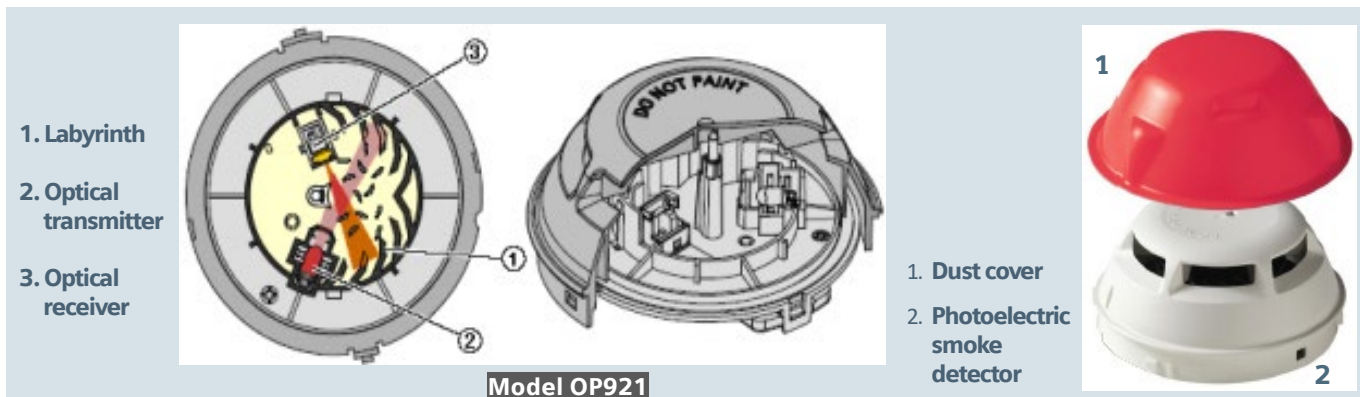

Sensitivity Settings

Application Parameter Sets

Model OP921 provides (2) pre-programmed sensitivity parameter sets that can be selected by the Siemens fire-alarm control panel in order to match the expected application or environmental conditions:

- Standard
- Air-Duct

Standard: This application parameter set, which is ideal for normal office | hotel-lobby-type applications, is the default setting.

Air-Duct: This application parameter set is used when the detector is used a UL268A (DI) compliant, direct in-air duct application without a duct housing.

Model OP921 does not require a field sensitivity test. Model OP921 is UL Listed as a self-testing device and complies with NFPA 72 as a self-monitoring detector and control-panel arrangement. This parameter set is also used when Model OP921 is used in air-duct housings (Models FDBZ492 and FDBZ492-HR).

A quick visual inspection is sufficient to indicate the condition of Model OP921 at any time. If more detailed information is required, a printed report can be provided from the compatible FACP, indicating the status and settings assigned to each individual detector. When Model OP921 moves to `Alarm` mode, the detector will flash **RED** and continue flashing until the system is reset at the FACP.

At that same time, any user-defined, system-alarm functions programmed into the system are activated.

Model OP921 contains a tri-color LED indicator, capable of flashing any one (1) of three (3) distinct colors: **GREEN** | **YELLOW** | **RED**.

During each flash interval, the microprocessor-based detector monitors the following scenarios:

- Smoke sensitivity is within the range indicated on the nameplate label
- Smoke in its sensing chamber
- Internal sensors and electronics are functional

Based on the results of the monitoring, the LED indicator flashes the following:

| FLASH COLOR | CONDITION | FLASH INTERVAL [in seconds] |
|------------------|--|--------------------------------|
| GREEN* | Normal supervisory operation. Smoke sensitivity is within rated limits. | 10 |
| YELLOW: | Detector is in trouble and needs replacement. | 4 |
| RED: | `Alarm` condition | 1 |
| NO FLASH: | Detector is not powered. | — |

* denotes LED can be turned OFF

Please follow the corresponding description of the panel used.

A quick visual inspection is sufficient to indicate the condition of the detector at any time. If more detailed information is required, a printed report can be provided from the respective Cerberus PRO Modular | FireFinder XLS/IV | FC/FV9-series FACP that indicates the status and settings assigned to each individual detector.

Installation


All Model OP921 intelligent, addressable detectors use a surface-mounting base (Model DB-11 or DB-11E), which mounts on a 4-inch (10.2 cm.) octagonal, square or single-gang electrical back box. The base utilizes screw-clamp contacts for electrical connections and self-wiping contacts for increased reliability.

The Model DB-11 detector base can be used with the optional Siemens Model LK-11 detector locking kit, which contains 50 detector locks and an installation tool to prevent unauthorized removal of the detector head. Model DB-11 has aesthetically conducive plugs to cover the outer mounting-screw holes.

Model OP921 may be installed on the same initiating circuit with the Siemens Model 'H'-series detectors [when used with Cerberus PRO Modular | FireFinder XLS/IV | FC/FV9-series FACP] –

Each detector, which is shipped with a protective dust cover, consists of the following:

- Built-in **ISOtechnology** for True-Class-X SLC performance
- Dust-resistant photoelectric chamber
- Microprocessor-based electronics with a low-profile plastic housing

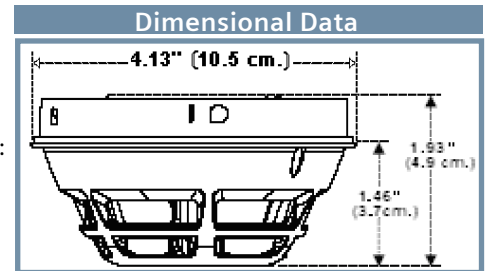

All Model OP921 intelligent, addressable detectors are approved for operation with the Underwriters' Laboratories-specified temperature range of 32° to 100°F (0° to 38°C). (See: installation manual P/N—A6V10323928 for further details)

Application Data

- XTRI series interface modules
- HTRI series interface modules
- HMS & XMS series manual stations
- HFP-11, HFPT-11 detection devices
- HCP output-control module
- HZM conventional zone module

Installation of Model OP921 smoke detectors require a two-wire circuit. In many retrofit cases, existing wiring may be used. 'T-tapping' is permitted only for Style 4 (Class B) wiring. Model OP921 is polarity insensitive, which can greatly reduce installation and debugging times. When operating in NFPA 72 Class-X applications SLC polarity must be maintained to support up to 252 isolation ready devices per loop. When used in mixed mode a maximum of 30 non-isolated devices between isolation devices (wired in polarity-insensitive mode). See control panel install document for further details.

Model OP921 detectors can be applied within the maximum 30-foot center spacing (900 sq. ft. areas) as referenced in NFPA 72. This application guideline is based on ideal conditions – specifically, smooth ceiling surfaces, minimal air movement, and no physical obstructions between potential fire sources and the actual detector. Do not mount detectors in close proximity to ventilation or heating and air conditioning outlets. Exposed joists or beamed ceilings may also affect safe spacing limitations for detectors.

Should questions arise regarding detector placement, observe NFPA 72 guidelines. Good fire-protection-system engineering and common sense dictate how and when fire detectors are installed and used. Contact your local Siemens – Fire Safety distributor or sales office whenever you need assistance applying Model OP921 in unusual applications. Be sure to follow NFPA guidelines and UL Listed / ULC Listed installation instructions – included with every Siemens – Fire Safety detector – and local codes as for all fire protection equipment.

Field-Device Programmer / Test Unit

Model OP921 is compatible with the Siemens field-device programmer / test unit (Model 8720 | DPU), which is a compact, portable menu-driven accessory for electronically programming and testing these addressable detectors promptly and reliably. For instance, the field technician selects the accessory's program mode, and enters the desired address.

Model DPU eliminates the need for cumbersome, unreliable mechanical programming methods (e.g. – dials and rotary switches), and reduces installation and service costs by electronically programming and testing the detector prior to installation. When set in 'test' mode, Model DPU will perform a series of diagnostic tests without altering the address or other stored data, allowing technicians to determine if the detector is operating properly.

Each field-device programmer / test unit operates on AC power or rechargeable batteries, providing flexibility and convenience in the programming / testing of fire-safety equipment from practically any location. Additionally, with the use of a Model DPU unit, there is no longer a cause for concern with any vibration, corrosion and other deteriorating conditions that can accompany the vitality of electro-mechanical-addressing mechanisms.

Each detector fits into one (1) wall-or-ceiling footprint, and only occupies one (1) address on the signal-line circuit (SLC).

| Technical Data | |
|------------------------------|---|
| OPERATING TEMPERATURE: | +32° – +100°F (0° – +38°C) |
| RELATIVE HUMIDITY: | 0 – 95% (non-condensing) |
| AIR PRESSURE: | No effect |
| AIR VELOCITY: | 0 – 4,000 feet-per-minute (fpm) (0 – 20 meters-per-second) |
| INPUT VOLTAGE RANGE: | 16VDC – 30VDC |
| 'ALARM' CURRENT, MAX.: | 410µA |
| 'STANDBY' CURRENT, MAX.: | 250µA |
| MAXIMUM SPACING: | 30-ft. centers (900 sq. ft.), per NFPA 72 |
| DETECTOR WEIGHT: | 0.317 Lbs. (0.144 kg.) |
| MECHANICAL PROTECTION GUARD: | UL and ULC Listed (with STI Guard Model STI-9604) |
| SENSITIVITY RANGE: | 1.41 - 3.76 % ft obs. (Nominal 2.0% / ft. obs.) |

| Panel Compatibilities | | |
|-----------------------|-------------|--|
| MODEL OR TYPE | DATA SHEET | PANEL |
| XLS | 6300 | FireFinder® (fire) |
| XLSV | 6340 | FireFinder (fire w/ voice) |
| Cerberus PRO Modular | 8300 | System Overview |
| FC901 | 9813 | Cerberus PRO 50-point addressable |
| FC922 | 9815 | Cerberus PRO 252-pt. addressable (fire) |
| FC924 | | Cerberus PRO 504-pt. addressable (fire) |
| FV922 | 9821 | Cerberus PRO 252-point addressable (fire w/ Intelligent Voice Communication [IVC]) |
| FV924 | | 504-pt. addressable (fire w/ Intelligent Voice Communication [IVC]) |

| Details for Ordering | | |
|--|---------------|--|
| MODEL OR TYPE | PART NUMBER | PRODUCT |
| OP921 | S54320-F4-A2 | Photoelectric Smoke Detector |
| Compatible Devices: | | |
| MODEL OR TYPE | PART NUMBER | PRODUCT |
| ABHW-4B | S54320-F13-A1 | Buzzer Version Audible Base (standard 3,000 Hz tone) |
| ABHW-4BZ | S54320-F13-A2 | Audible Base |
| ABHW-4S | S54320-F14-A1 | Sleeping Room Version, 520 Hz Low Frequency Audible Base |
| ABHW-4SZ | S54320-F14-A2 | Audible Base |
| DB-11 | 500-094151 | Detector Mounting Base |
| DB-11E | 500-094151E | Detector Base, small |
| DB2-HR | S54370-F12-A1 | Detector Mounting Base with Relay |
| RL-HC | 500-033230 | Remote Alarm Indicator: 4" (10.2 cm) octagon-box mount, red |
| RL-HW | 500-033310 | Remote Alarm Indicator: single-gang box mount, red |
| FDBZ492 | S54319-B22-A1 | Addressable Air-Duct Housing |
| FDBZ492-HR | S54319-B23-A1 | Addressable Air-Duct Detector with Relay |
| LK-11 | 500-695350 | Base Locking Kit |
| See: www.STI-USA.com for further details on ordering Model STI-9604 | | |
| In Canada order: | | |
| MODEL OR TYPE | PART NUMBER | PRODUCT |
| DB-11C | 500-095687 | Detector Mounting Base, ULC Listed |

NOTICE – The information contained in this data-sheet document is intended only as a summary, and is subject to change without notice. The product(s) described here has/have a specific instruction sheet(s) that cover various technical, limitation and liability information.

Copies of install-type, instruction sheets – as well as the *General Product Warning and Limitations* document, which also contains important data, are provided with the product, and are available from the Manufacturer.

Data contained in the aforesaid type of documentation should be consulted with a fire-safety professional before specifying or using the product.

Any further questions or assistance concerning particular problems that might arise, relative to the proper functioning of the equipment, please contact the Manufacturer.

SIEMENS

Cerberus® PRO

Siemens Industry, Inc.
Smart Infrastructure - Building Products
2 Gatehall Drive • Parsippany, NJ 07054
Tel: (973) 593-2600

March - 2024
(Rev. 14)